



M150

CONT 140 kVA



THREE-PHASE SYNCHRONOUS GENERATOR

Datasheet for 4 poles -50Hz @ 1500rpm/ 60Hz @ 1800rpm

Ambient Temperature	40 °C	Method of Cooling	Air cooling	
Temperature Rise	125 °C	Direction of Rotation	Clockwise	
Insulation Class	H	Maximum Over-speed	2250r/min	
Power Factor	0.8	Degree of Protection / Enclosure	IP23	
Excitation	Brushless	Altitude	1000m	
Winding Pitch	2/3	Stator winding	DLL	
Pole	4	Number of Terminal	12	
Duty	S1- Continuous	Rotor	With damping cage	
Waveform	TIF<50		THF<2%	
Waveform distortion	BS EN 61000-6-2&BS EN 61000-6-4,VDE 0875G,VDE0874N			
Radio interference	Noload<1.5%,Non-distorting balanced linear load<5%			
AVR MODEL AVR	Standard	Selection		PMG
	SX460	AS440	KRS440	MX341B MX321
Voltage Regulation - in steady state condition	±1.0	±1.0	±1.0	±0.5 ±0.5
Short Circuit Current Capacity	Control does not sustain a short circuit current			630A

Electrical Characteristic

Frequency	Hz	50				60			
Voltage (series star) Y	V	380/220	400/231	415/240	440/254	416/240	440/254	460/266	480/277
Voltage (parallel star) YY	V	190/110	200/115	208/120	220/127	208/120	220/127	230/133	240/138
Voltage (series delta) Δ	V	220	230	240	254	240	254	266	277
Rated power at Class H (125 °C) temperature rise	kVA	140	140	140	N/A	160	167.5	167.5	178.8
	kW	112.0	112.0	112.0	N/A	128.0	134.0	134.0	143.0
Efficiency at Class H (P.F.=0.8)	4/4%	91.2	91.7	92	N/A	91.3	91.7	92	92.1
	3/4%	92.2	92.5	92.7	N/A	92.3	92.6	92.7	92.8
	2/4%	92.8	92.9	92.9	N/A	92.9	93	93	93
Efficiency at Class H (P.F.=1.0)	4/4%	93.1	93.5	93.7	N/A	93.1	93.4	93.7	93.8
	3/4%	94	94.2	94.3	N/A	94	94.1	94.3	94.4
	2/4%	94.5	94.5	94.6	N/A	94.3	94.5	94.6	94.6

Reactances (%) at Class H

Direct axis synchronous reactance unsaturated	Xd	2.34	2.11	1.96	N/A	2.68	2.51	2.29	2.25
Direct axis transient reactance saturated	X'd	0.21	0.19	0.18	N/A	0.25	0.23	0.21	0.21
Direct axis subtransient reactance saturated	X''d	0.14	0.13	0.12	N/A	0.17	0.16	0.15	0.14
Quadrature axis synchronous reactance unsaturated	Xq	1.53	1.38	1.28	N/A	1.74	1.63	1.49	1.46
Quadrature axis subtransient reactance saturated	X''q	0.18	0.16	0.15	N/A	0.22	0.21	0.19	0.18
Leakage reactance	X1	0.08	0.08	0.07	N/A	0.09	0.08	0.08	0.08
Negative sequence reactance saturated	X2	0.16	0.14	0.13	N/A	0.19	0.18	0.16	0.16
Zero sequence reactance unsaturated	X0	0.1	0.09	0.08	N/A	0.11	0.1	0.09	0.09
Short-circuit ratio	Kcc	0.4274	0.4739	0.5102	N/A	0.3731	0.3984	0.4367	0.4444

Short-circuit transient time constant (sec.)	T'd	0.032							
Subtransient time constant (sec.)	T''d	0.01							
Open circuit time constant (sec.)	T'do	0.85							
Armature time constant (sec.)	Ta	0.007							
Stator Winding Resistance (20°C)	ohm	0.0337							
Rotor Winding Resistance (20°C)	ohm	1.4							
Exciter Stator Resistance (20°C)	ohm	20							
Exciter Rotor Phase resistance	ohm	0.091							
No load excitation current	io (A)	0.5	0.52	0.6	N/A	0.5	0.51	0.52	0.53
Full load excitation current	ic(A)	2.4	2.4	2.5	N/A	2.4	2.4	2.5	2.5
Cooling air requirement	m ³ /sec	0.514m3/s 1090cfm				0.617m3/s 1308cfm			

Mechanical Characteristic


Configuration	Single Bearing	Double Bearing
Type of Construction	B2-SAE	IM B34
Total Weight - kgs	460	447
Weight wound stator - kgs	172	172
Weight wound rotor - kgs	167.51	156.55
Inertia (J) [kgm ²]	1.3271kgm ²	1.2765kgm ²
Drive end bearing / Lubrication		BALL.6315-2RS(ISO)
Non-drive end bearing / Lubrication	BALL.6310-2RS(ISO)	BALL.6310-2RS(ISO)
Packing crate size (cm)	98X63X94	104X63X94

Winding 311 / 0.8 Power Factor

RATINGS

Class - Temp Rise		Cont. F - 105/40°C				Cont. H - 125/40°C				Standby - 150/40°C				Standby - 163/27°C			
50 Hz	Series Star (V)	380	400	415	440	380	400	415	440	380	400	415	440	380	400	415	440
	Parallel Star (V)	190	200	208	220	190	200	208	220	190	200	208	220	190	200	208	220
	Series Delta (V)	220	230	240	254	220	230	240	254	220	230	240	254	220	230	240	254
	kVA	125.0	125.0	125.0	N/A	140.0	140.0	140.0	N/A	145.0	145.0	145.0	N/A	150.0	150.0	150.0	N/A
	kW	100.0	100.0	100.0	N/A	112.0	112.0	112.0	N/A	116.0	116.0	116.0	N/A	120.0	120.0	120.0	N/A
	Efficiency (%)	91.7	92.1	92.3	N/A	91.3	91.7	92.0	N/A	91.1	91.6	91.8	N/A	91.0	91.4	91.7	N/A
	kW Input	109.1	108.6	108.3	N/A	122.7	122.1	121.7	N/A	127.3	126.6	126.4	N/A	131.9	131.3	130.9	N/A
60 Hz	Series Star (V)	416	440	460	480	416	440	460	480	416	440	460	480	416	440	460	480
	Parallel Star (V)	208	220	230	240	208	220	230	240	208	220	230	240	208	220	230	240
	Series Delta (V)	240	254	266	277	240	254	266	277	240	254	266	277	240	254	266	277
	kVA	140.0	143.8	143.8	160.0	160.0	167.5	167.5	178.8	170.0	175.0	175.0	187.5	175.0	181.3	181.3	193.8
	kW	112.0	115.0	115.0	128.0	128.0	134.0	134.0	143.0	136.0	140.0	140.0	150.0	140.0	145.0	145.0	155.0
	Efficiency (%)	91.9	92.2	92.5	92.5	91.4	91.7	92.1	92.1	91.2	91.5	91.9	92.0	91.0	91.4	91.8	91.9
	kW Input	121.9	124.8	124.4	138.4	140.0	146.1	145.5	155.3	149.1	153.0	152.3	163.0	153.8	158.7	158.0	168.7




DIMENSIONS

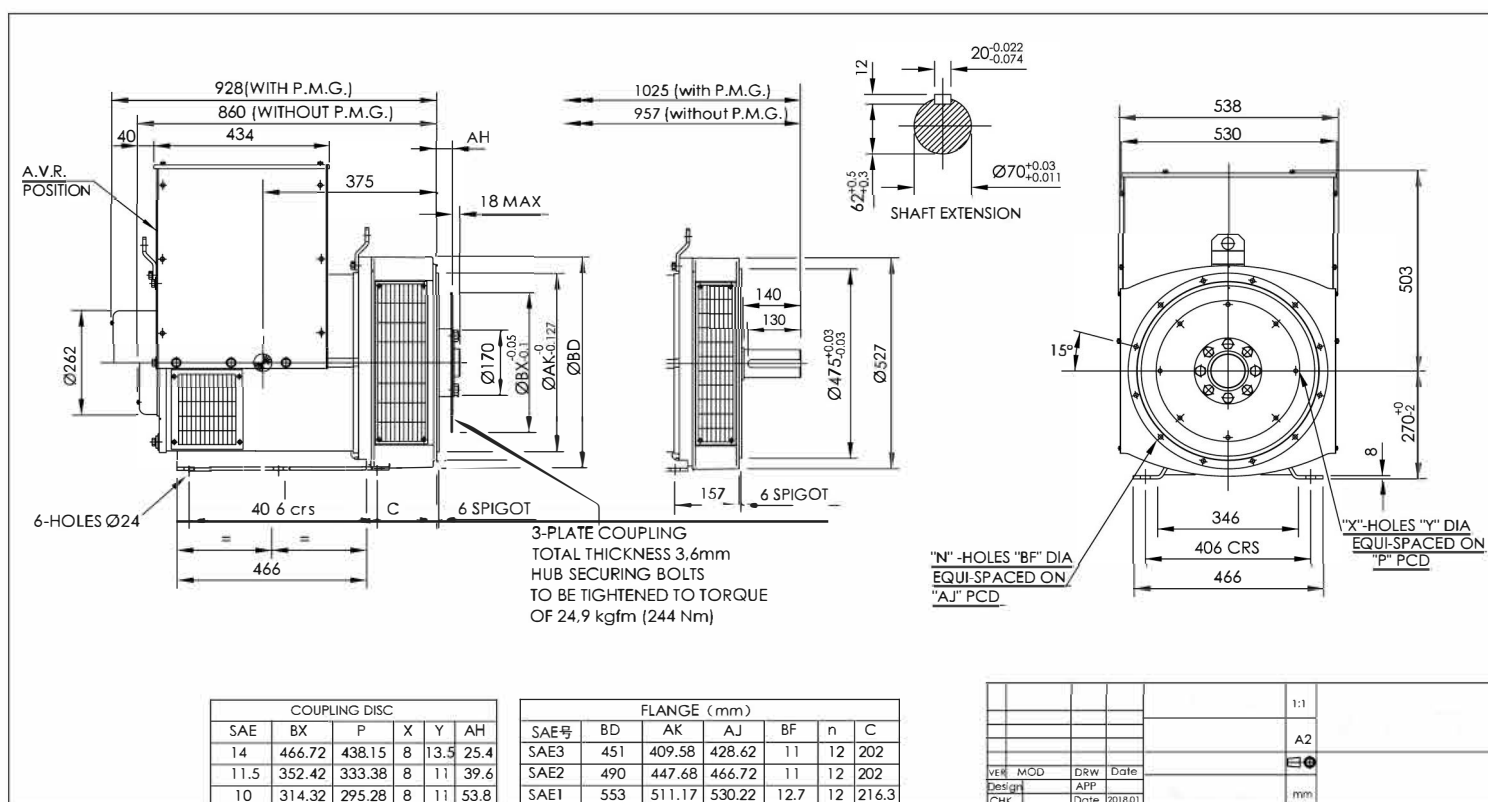

50
Hz

Winding 311





THREE PHASE EFFICIENCY CURVES

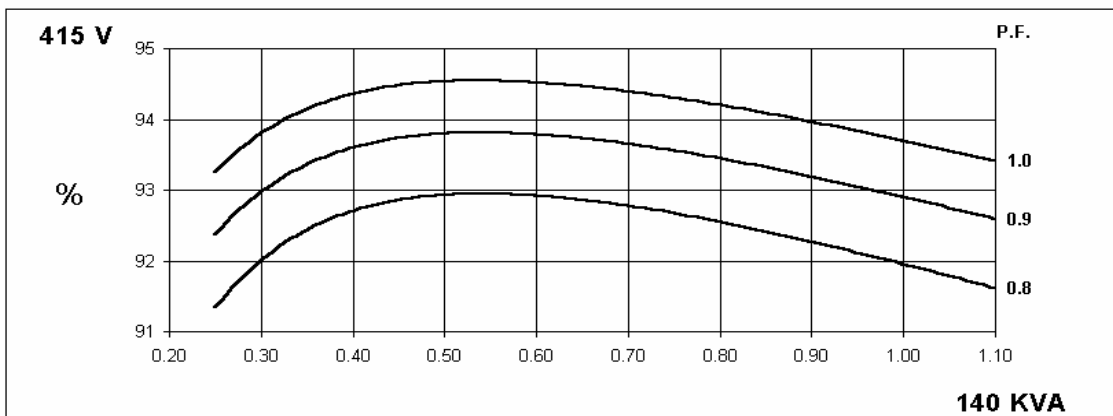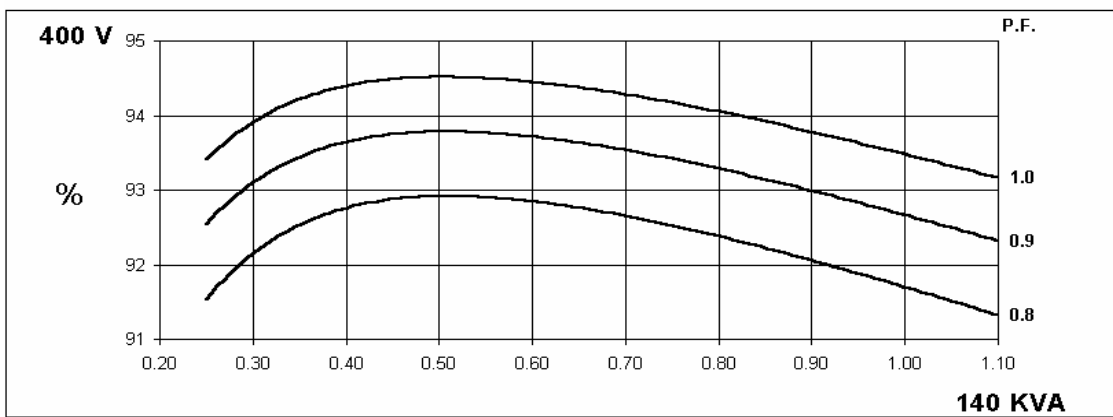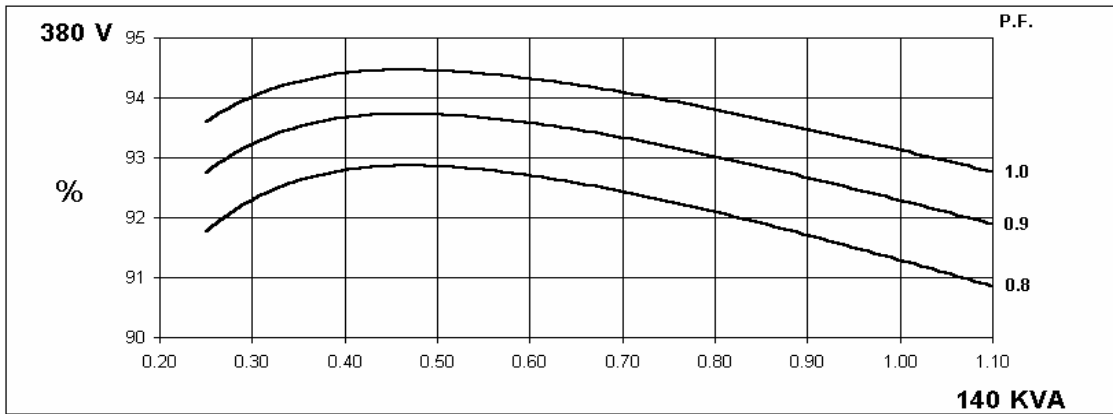

60
Hz


Winding 311

THREE PHASE EFFICIENCY CURVES

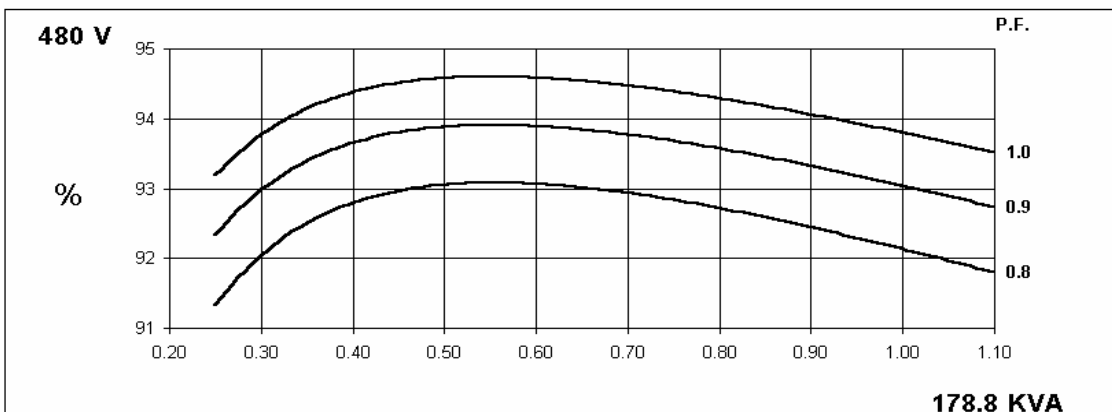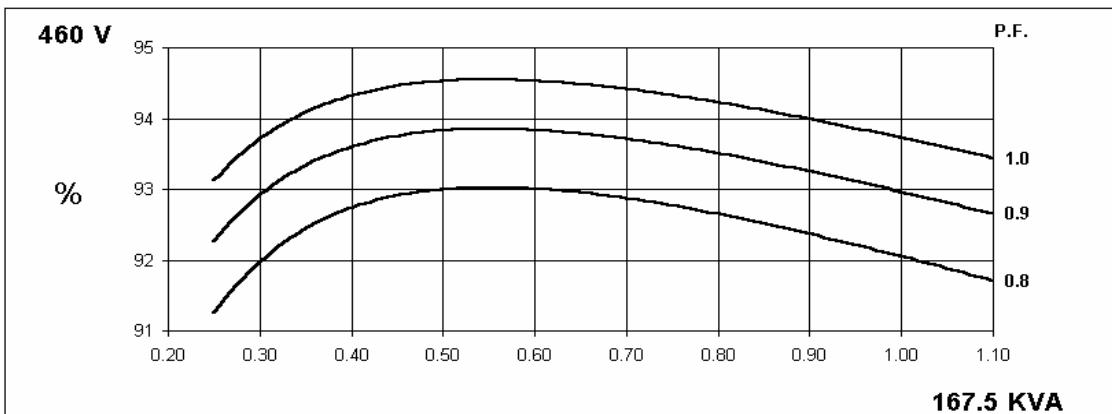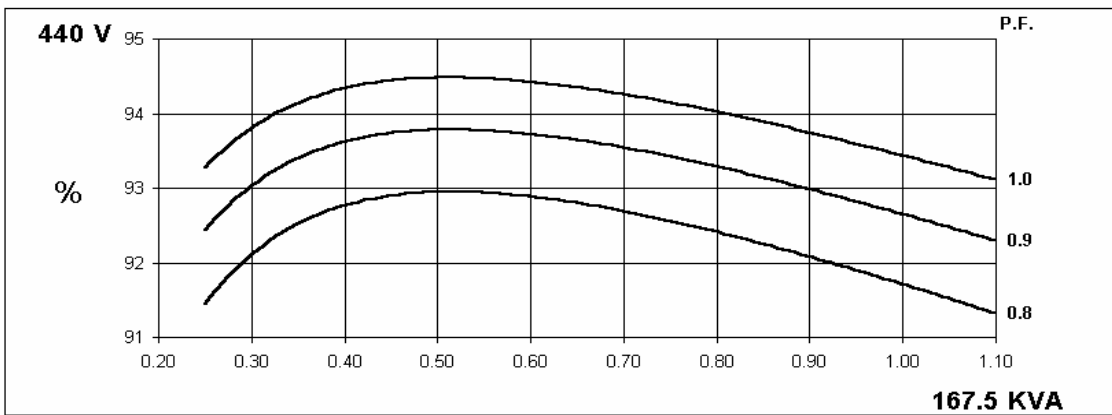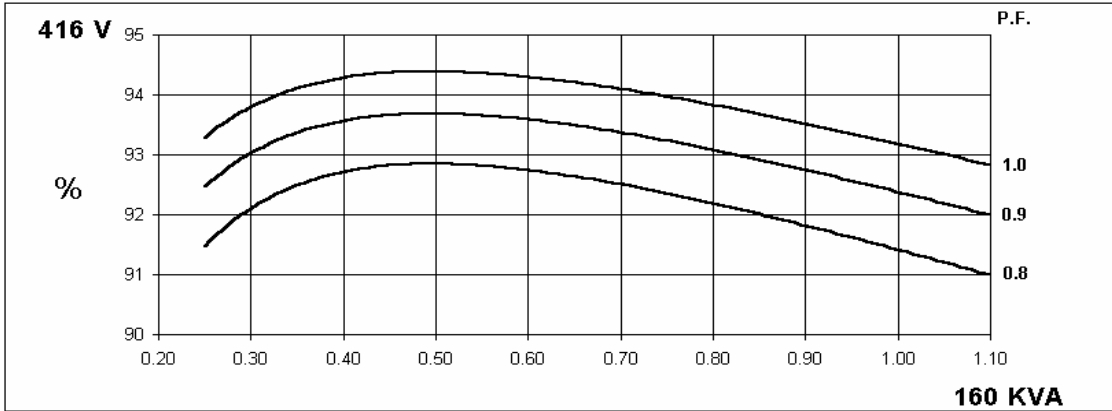


Three-phase Short Circuit Decrement Curve. No-load Excitation at Rated Speed Based on star (wye) connection.

50
Hz

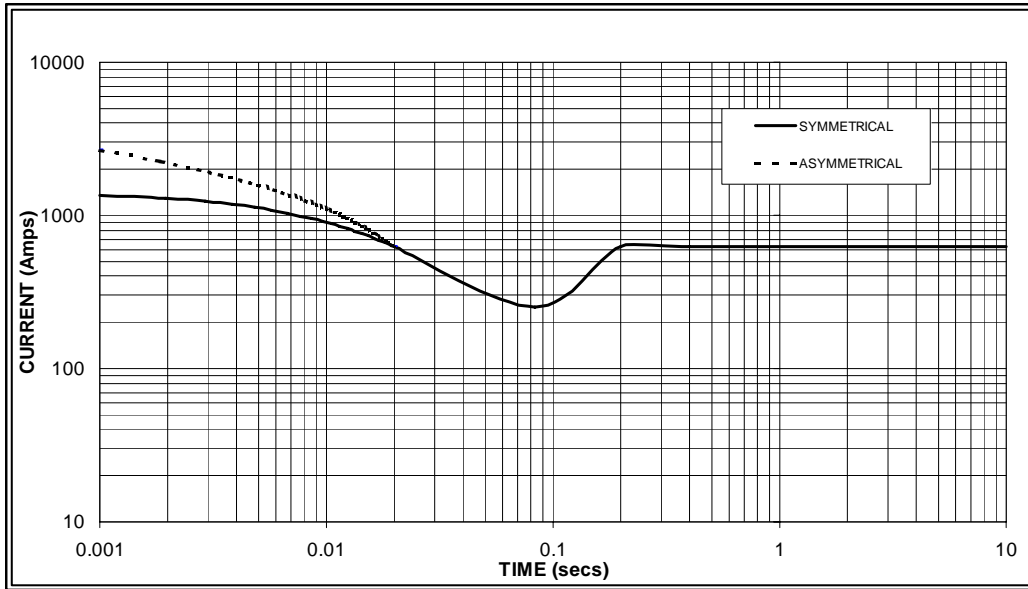

Sustained Short Circuit = 630 Amps

60
Hz

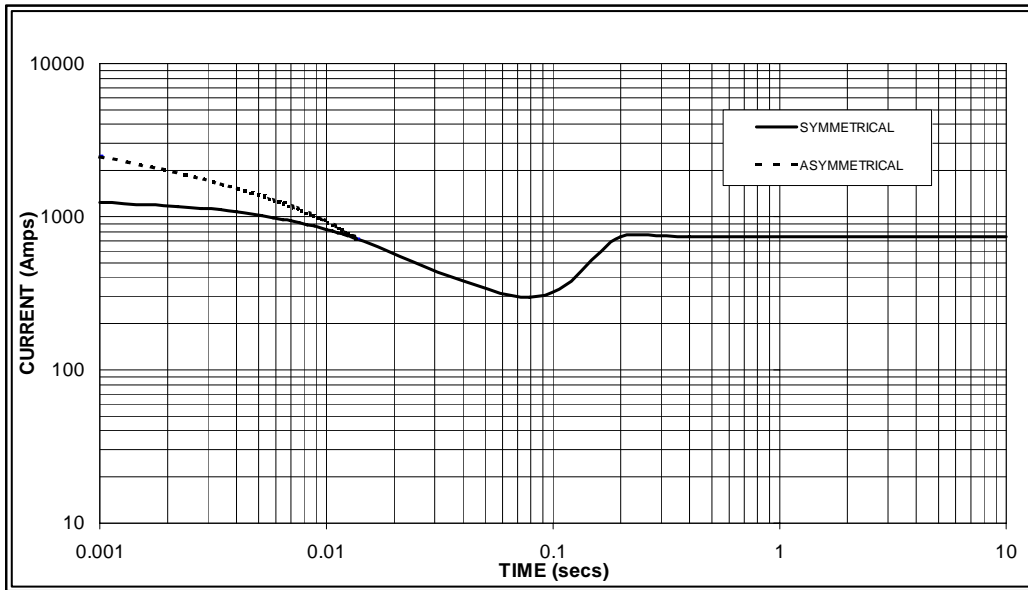

Sustained Short Circuit = 740 Amps

Note 1

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
380v	X 1.00	416v	X 1.00
400v	X 1.07	440v	X 1.06
415v	X 1.12	460v	X 1.12
		480v	X 1.17

The sustained current value is constant irrespective of voltage level

Note 2

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	x 1.00	x 1.50	x 2.50
Max. sustained duration	10 sec.	5 sec.	2 sec.


All other times are unchanged

Note 3

Curves are drawn for Star (Wye) connected machines. For other connection the following multipliers should be applied to current values as shown :

Parallel Star = Curve current value X 2


Series Delta = Curve current value X 1.732

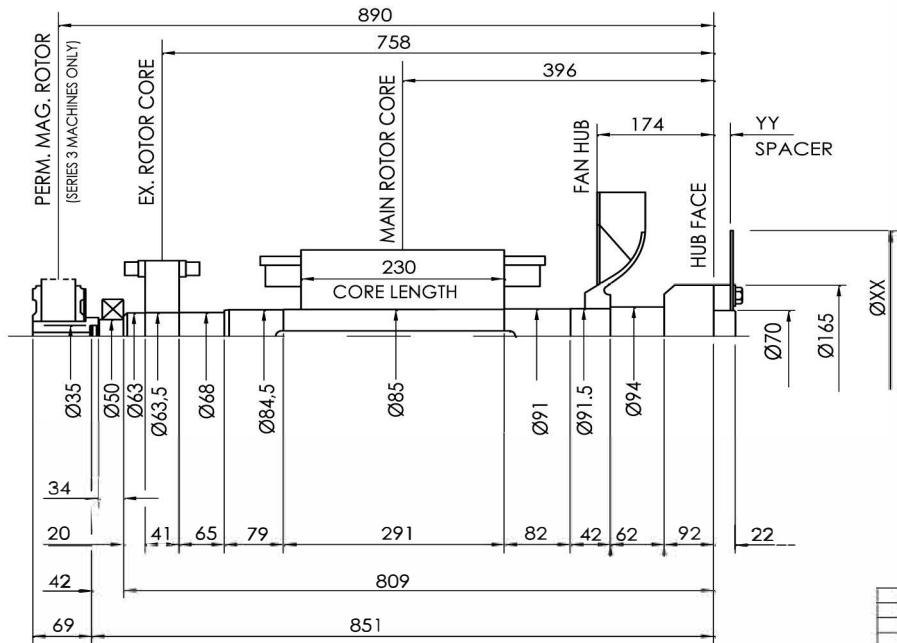

COMPONENT	Wt kg	J kgm ²
EX. ROTOR	12.28	0.0726
MAIN ROTOR	99.79	1.088
FAN	3.389	0.0709
SHAFT	35.726	0.0315
HUB	10.878	0.0491
TOTAL	162.063	1.3121
PERM. MAG.	5.450	0.0150
TOTAL	167.513	1.3271

COUPLING SAE No	COUPLING DIMEN'S		COUPLING ASSEMBLY WEIGHT kg	COUPLING DISC J kgm ²
	XX	YY		
* 10	314	14.3	5.55	0.0266
* 11½	352	-	2.64	0.0423
! 11½	352	14.3	4.95	0.0423
! 14	467	-	4.74	0.1317

VER	MOD	DRW	Date	1:1
Design	APP			⊕
CHK	Date	2018.01		mm

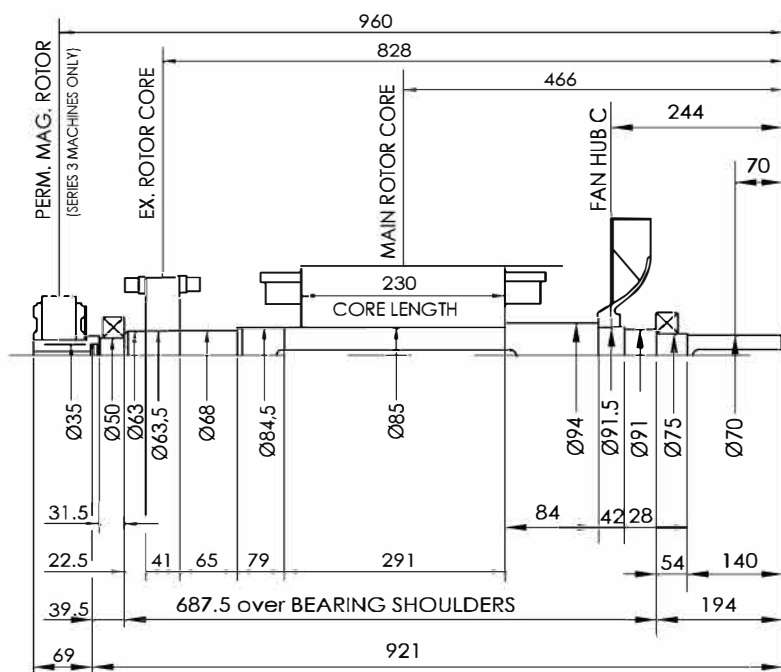

COMPONENT	Wt kg	J kgm ²
EX. ROTOR	12.28	0.0726
MAIN ROTOR	99.79	1.088
FAN	3.389	0.0709
SHAFT	35.642	0.03
TOTAL	151.101	1.2615
PERM. MAG.	5.450	0.0150
TOTAL	156.551	1.2765

VER	MOD	DRW	Date	1:1
Design	APP			⊕
CHK	Date	2018.01		mm

